
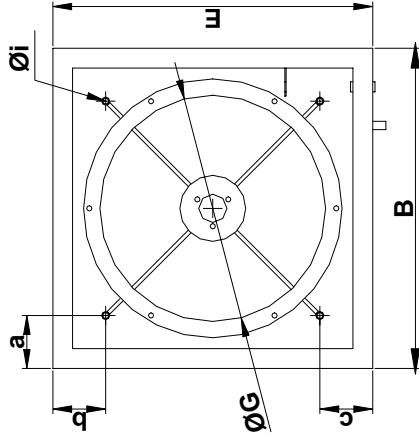


Installation

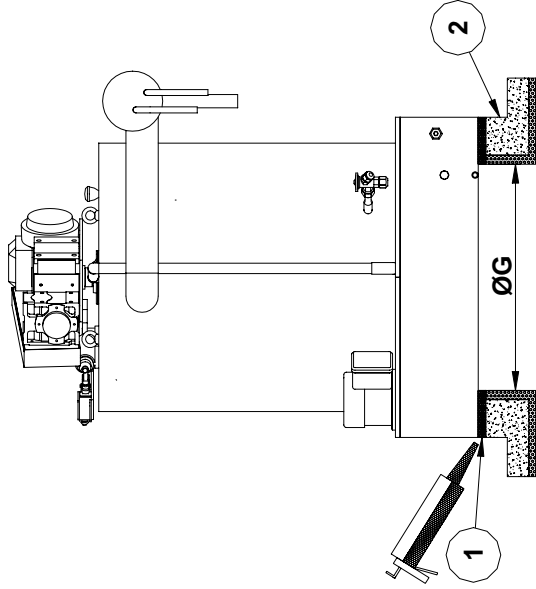

- 1 Tightness seal around the boring
- 2 Raising of the floor to avoid accidental water leaks in the storage
- D1 Minimum clearance for reducer removal
- D2 Minimum clearance for reamer removal
- G Ice chute
- k Fixation sleeves height of the base (Øi)

A	500	F	200
B	630	G	500
C	400	H1	820
D	1000	H2	1020
D1	300	H3	1020
D2	680	I	775
E	630	L	925


a	87
b	87
c	87
i	12
k	150

* Dimensions in mm

Handling


1 Two lifting eyes

Net weight **230 kg**

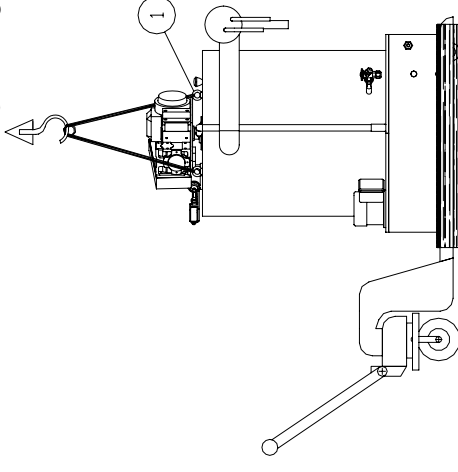

Minimum clearance for service

We advise to foresee enough space around the system for its inspection and maintenance

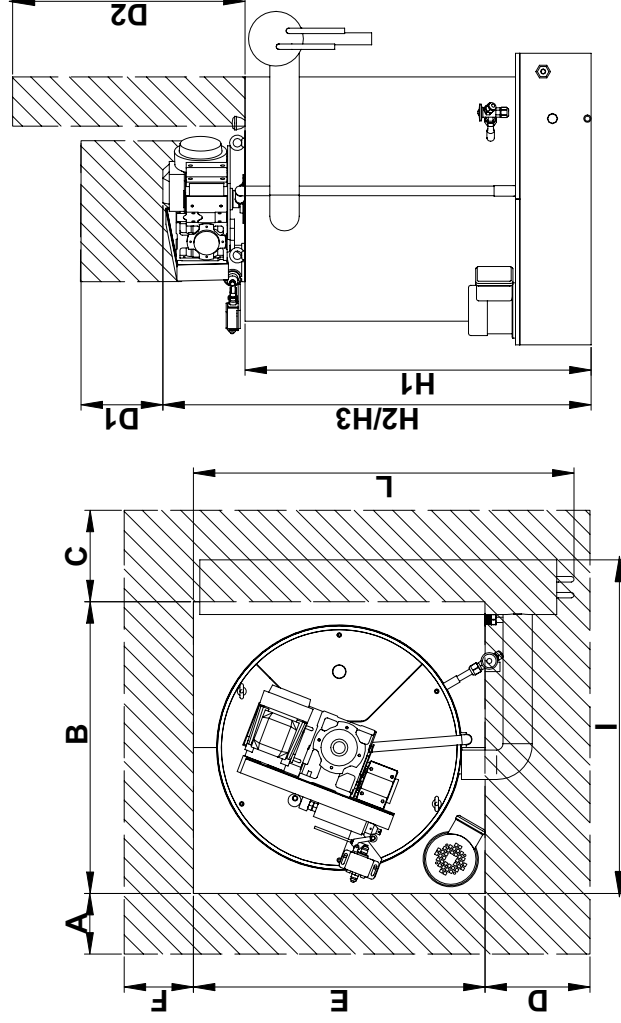

GENEGLACE s.a.s.



ZAC de la Forêt - 9, rue des Orfèvres
44840 Les Sorinières - France

Tél. +33-(0)2-51-19-10-51 Fax +33-(0)2-40-05-73-81

Installation and handling

Generator F90 - H115

SEMI-INDUSTRIAL LAND-BASED

Edition date 05/10/2004 V1.0

GTI.001A

GENEGLACE may change this document without prior notice

Cancels and replaces the document of 01/04/2004